


# Status of Water Fluoridation in Oklahoma

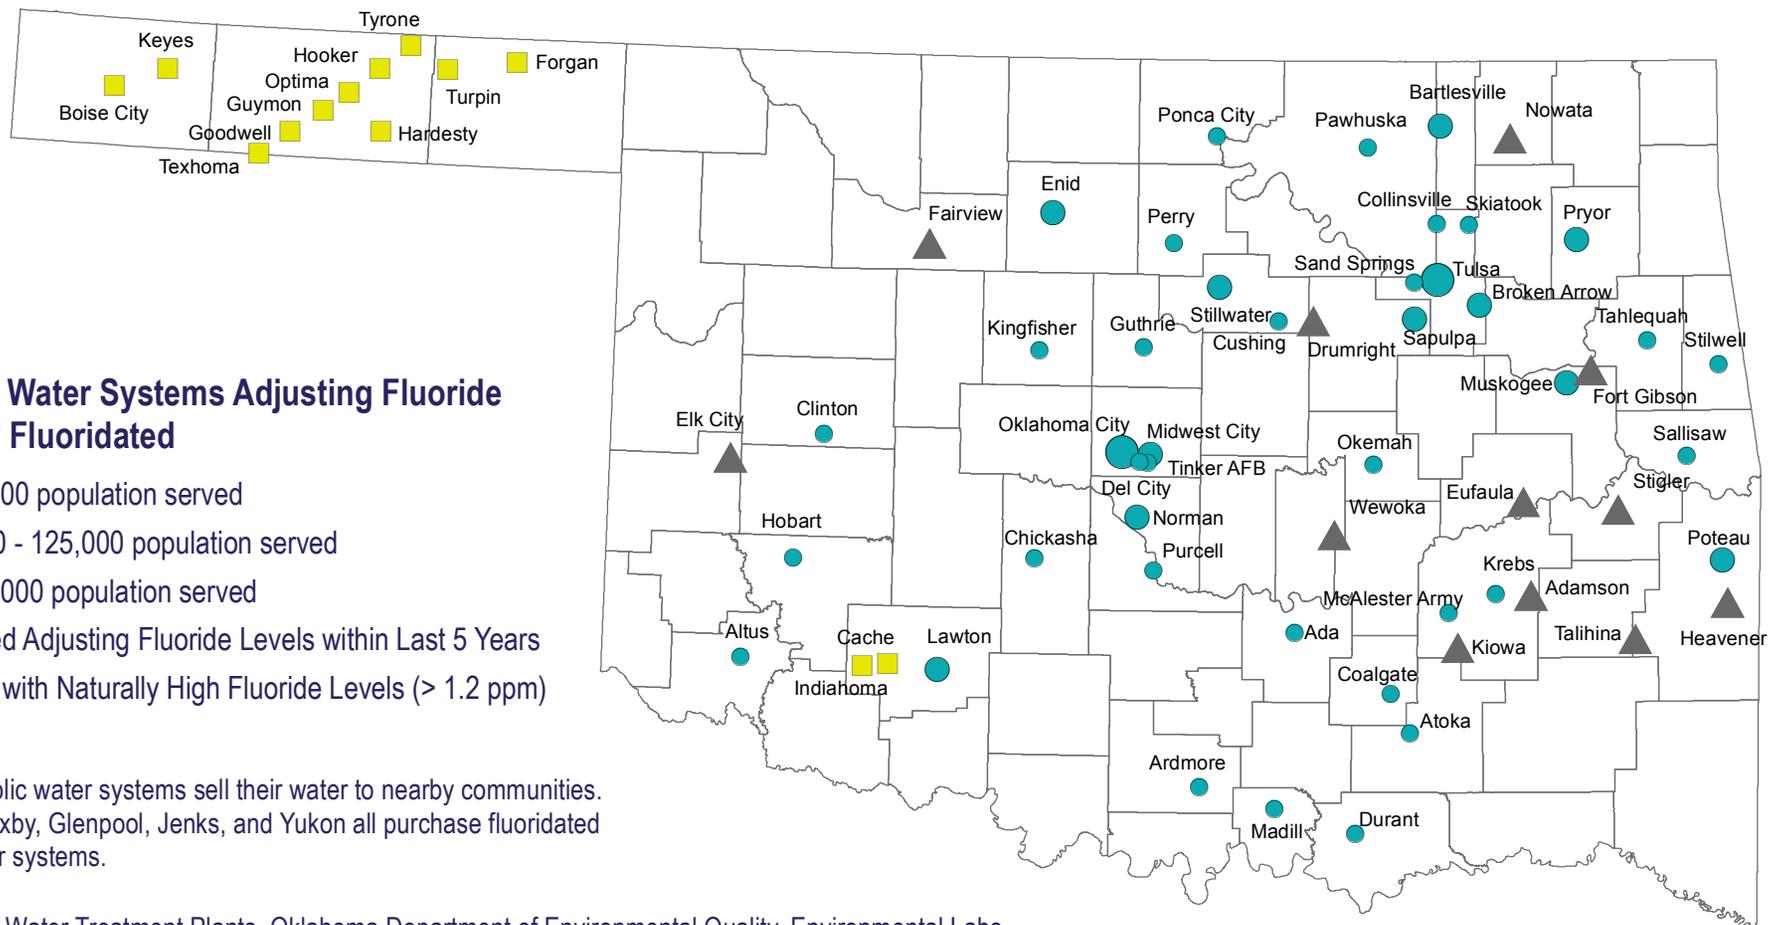

## Community Water Systems Adjusting Fluoride or Naturally Fluoridated

- < 30,000 population served
- 30,000 - 125,000 population served
- > 125,000 population served
- ▲ Ceased Adjusting Fluoride Levels within Last 5 Years
- Areas with Naturally High Fluoride Levels (> 1.2 ppm)

**Note:** Many public water systems sell their water to nearby communities. For example, Bixby, Glenpool, Jenks, and Yukon all purchase fluoridated water from other systems.

**Data Sources:** Water Treatment Plants, Oklahoma Department of Environmental Quality, Environmental Labs, Centers for Disease Control and Prevention, Oklahoma Dental Loan Repayment Program - Dental Health Professional Shortage Areas. Data Compiled by Dental Health Service, September 2015.

Projection/Coordinate System: USGS Albers Equal Area Conic



**Disclaimer:** This map is a compilation of records, information and data from various city, county and state offices and other sources, affecting the area shown, and is the best representation of the data available at the time. The map and data are to be used for reference purposes only. The user acknowledges and accepts all inherent limitations of the map, including the fact that the data are dynamic and in a constant state of maintenance.



Dental Health Service  
Community and Family Health Services  
Oklahoma State Department of Health  
Map created by Health Care Information  
on 12.21.2009. Revised by Community  
Epidemiology and Evaluation 10.22.2015