


Status of Water Fluoridation in Oklahoma

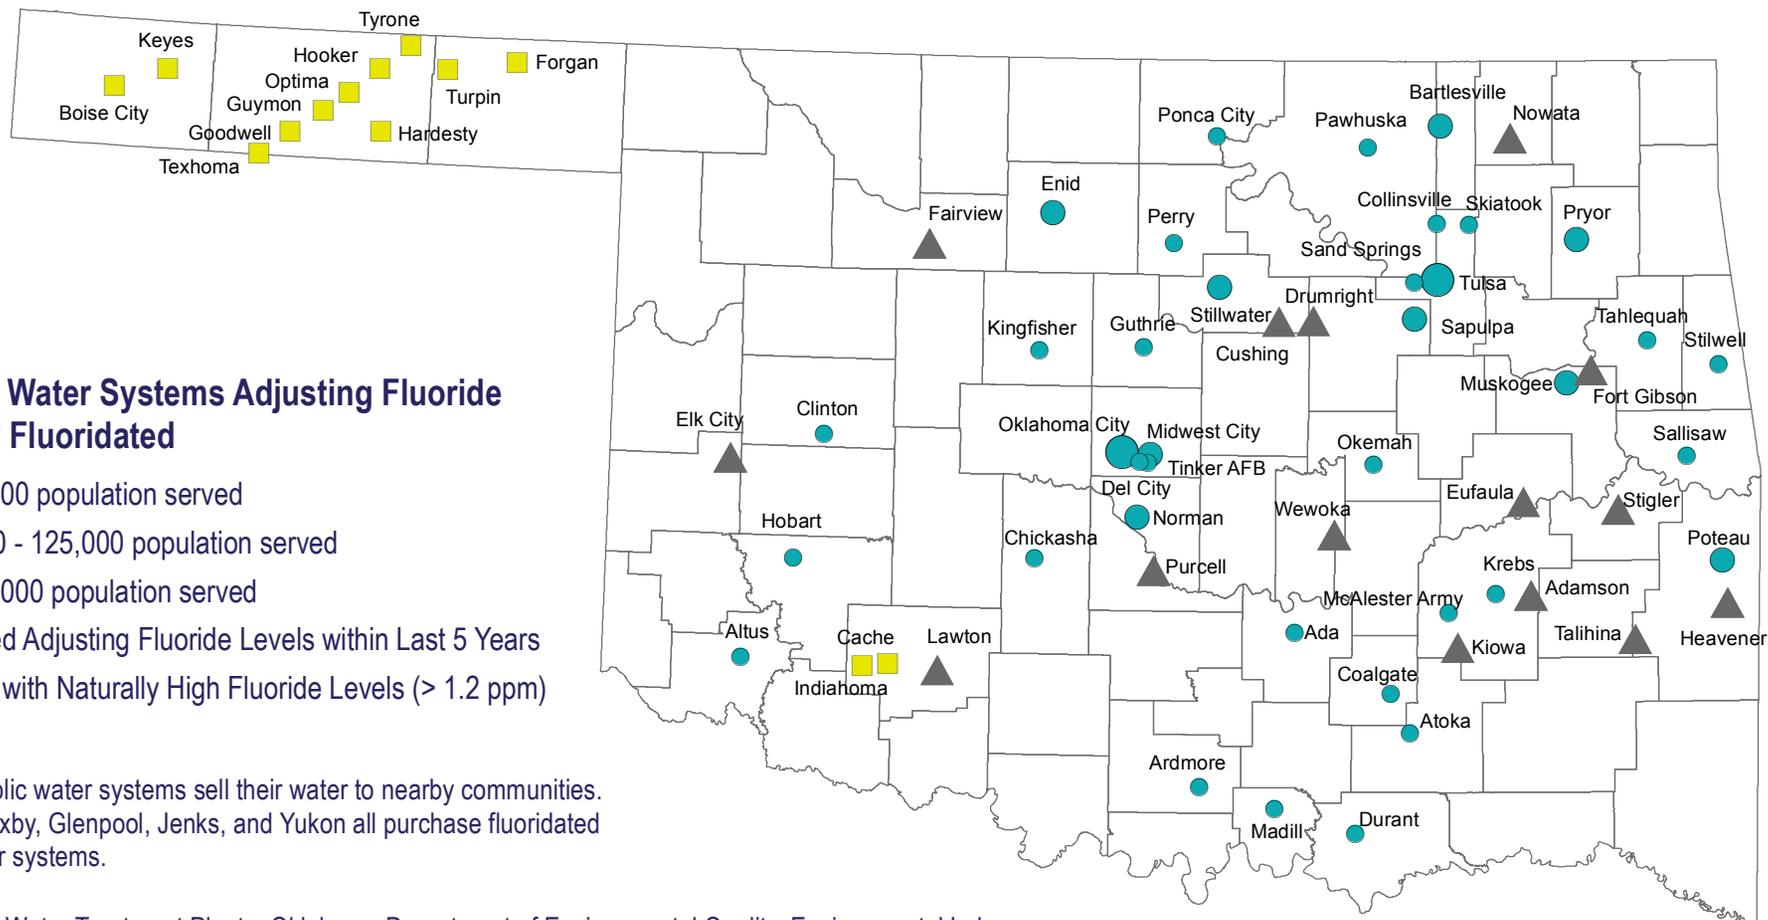

Community Water Systems Adjusting Fluoride or Naturally Fluoridated

- < 30,000 population served
- 30,000 - 125,000 population served
- > 125,000 population served
- ▲ Ceased Adjusting Fluoride Levels within Last 5 Years
- Areas with Naturally High Fluoride Levels (> 1.2 ppm)

Note: Many public water systems sell their water to nearby communities. For example, Bixby, Glenpool, Jenks, and Yukon all purchase fluoridated water from other systems.

Data Sources: Water Treatment Plants, Oklahoma Department of Environmental Quality, Environmental Labs, Centers for Disease Control and Prevention, Oklahoma Dental Loan Repayment Program - Dental Health Professional Shortage Areas. Data Compiled by Dental Health Service, October 2014.

Projection/Coordinate System: USGS Albers Equal Area Conic



Disclaimer: This map is a compilation of records, information and data from various city, county and state offices and other sources, affecting the area shown, and is the best representation of the data available at the time. The map and data are to be used for reference purposes only. The user acknowledges and accepts all inherent limitations of the map, including the fact that the data are dynamic and in a constant state of maintenance.



Dental Health Service
Community and Family Health Services
Oklahoma State Department of Health
Map created by Health Care Information
on 12.21.2009. Revised by Community
Epidemiology and Evaluation 10.22. 2014